


THIS DRAWING IS THE PROPERTY OF INDUSTRIAL COMBUSTION, DIV. OF AQUA-CHEM, INC.
 IT IS SUBJECT TO CHANGE WITHOUT NOTICE, AND IS NOT TO BE COPIED OR USED IN ANY WAY DETRIMENTAL TO THE COMPANY.

NOTE: EACH MOTOR OR HEATER IS TO BE FUSED SEPARATELY (BY OTHERS)

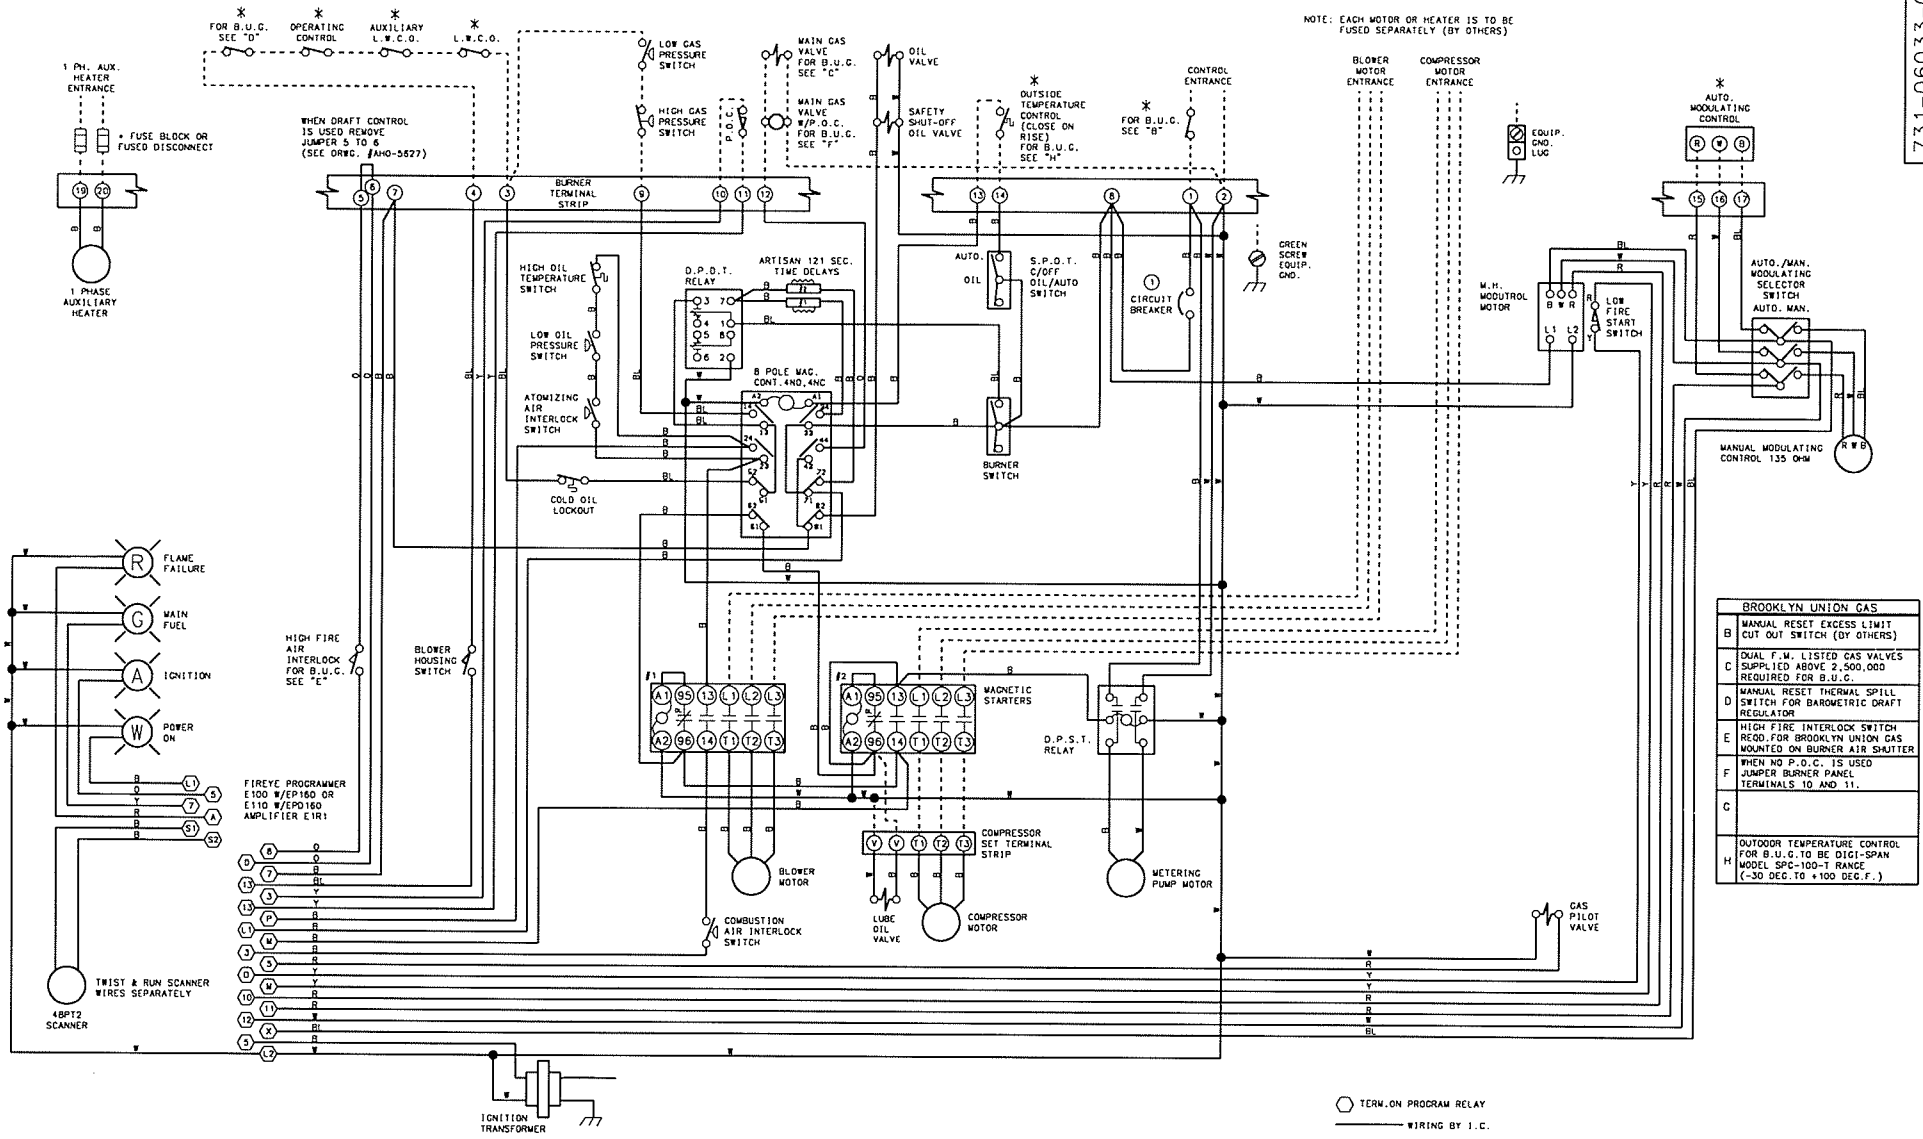

BROOKLYN UNION GAS	
B	MANUAL RESET EXCESS LIMIT CUT OUT SWITCH (BY OTHERS)
C	DUAL F.W. LISTED GAS VALVES SUPPLIED ABOVE 2,500,000 REQUIRED FOR B.U.C.
D	MANUAL RESET THERMAL SPILL SWITCH FOR BAROMETRIC DRAFT REGULATOR
E	HIGH FIRE INTERLOCK SWITCH REQD. FOR BROOKLYN UNION GAS MOUNTED ON BURNER AIR SHUTTER
F	WHEN NO P.O.C. IS USED JUMPER BURNER PANEL TERMINALS 10 AND 11.
C	
H	OUTDOOR TEMPERATURE CONTROL FOR B.U.G. TO BE DIGI-SPAN MODEL SPC-100-T RANGE (-30 DEG. TO +100 DEG. F.)

○ TERM. ON PROGRAM RELAY
 — WIRING BY I.C.
 - - - - - WIRING BY OTHERS

THIS DRWG. REPLACES #0-731-06033-00

WARNING: THESE DRAWINGS ARE TO BE USED ONLY IN CONNECTION WITH EQUIPMENT COMPLYING WITH THE ORIGINAL MANUFACTURER'S SPECIFICATIONS. INSTALLATION OF EQUIPMENT WITHOUT STRICT ADHERENCE TO THE ORIGINAL MANUFACTURER'S SPECIFICATIONS BEFORE USING THESE DRAWINGS, DO NOT USE THESE DRAWINGS IF THE EQUIPMENT HAS BEEN MODIFIED. SUCH USES CAN CAUSE EQUIPMENT FAILURE OR DAMAGE, WHETHER DIRECT, INDIRECT, INCIDENTAL OR CONSEQUENTIAL, RESULTING IN PERSONAL INJURY AND PROPERTY DAMAGE. INDUSTRIAL COMBUSTION DISCLAIMS ANY AND ALL LIABILITY FOR ANY INJURY OR DAMAGE, WHETHER DIRECT, INDIRECT, INCIDENTAL OR CONSEQUENTIAL, RESULTING FROM USE OF THESE DRAWINGS IN CONNECTION WITH EQUIPMENT WHICH DOES NOT COMPLY IN ALL RESPECTS WITH THE MANUFACTURER'S ORIGINAL SPECIFICATIONS.

REVISIONS	DATE	BY	CHKD.
1	11/10/74	CE	
2	07/27/75	KE	
3	04/07/75	KE	
4	03/17/77	DR	
5	03/17/77	DR	
6	03/17/77	DR	
7	03/17/77	DR	
8	03/17/77	DR	
9	03/17/77	DR	
10	03/17/77	DR	
11	03/17/77	DR	
12	03/17/77	DR	
13	03/17/77	DR	
14	03/17/77	DR	
15	03/17/77	DR	
16	03/17/77	DR	
17	03/17/77	DR	
18	03/17/77	DR	
19	03/17/77	DR	
20	03/17/77	DR	
21	03/17/77	DR	
22	03/17/77	DR	

WIRE COLOR	SYMBOL	WIRE ALL CIRCUITS IN E.C. CIRCLES; NOT RESPONSIBLE FOR WIRING NOT INSTALLED AT THE FACTORY.
YELLOW	Y	
ORANGE	O	
RED	R	
BLUE	B	
WHITE	W	○ SUPPLEMENTARY LOW OVERCURRENT PROTECTION ONLY - FUSE NOT LARGER THAN 15 AMPS
BLACK	B	

731-06033	SCALE	* OPTIONAL EQUIPMENT NOT FURNISHED UNLESS SPECIFIED IN CONTRACT
	DATE	DEC-42, 54, 63, 84, 105
	DRWN	LV-190-600/3/60
		CC-120/1/60

04/01/94	INDUSTRIAL COMBUSTION
C.E.B.	MONROE, WIS. DIVISION OF AQUA-CHEM, INC.

SIZE D	DRWG. NO. 731-06033	04
--------	---------------------	----