THIS DRAWING IS THE PROPERTY OF INDUSTRIAL COMBUSTION, DIV. OF AQUA-CHEM,INC.
IT IS SUBJECT TO CHANGE WITHOUT NOTICE, AND IS NOT TO BE COPIED OR USED IN ANY WAY DETRIMENTAL TO THE COMPANY.

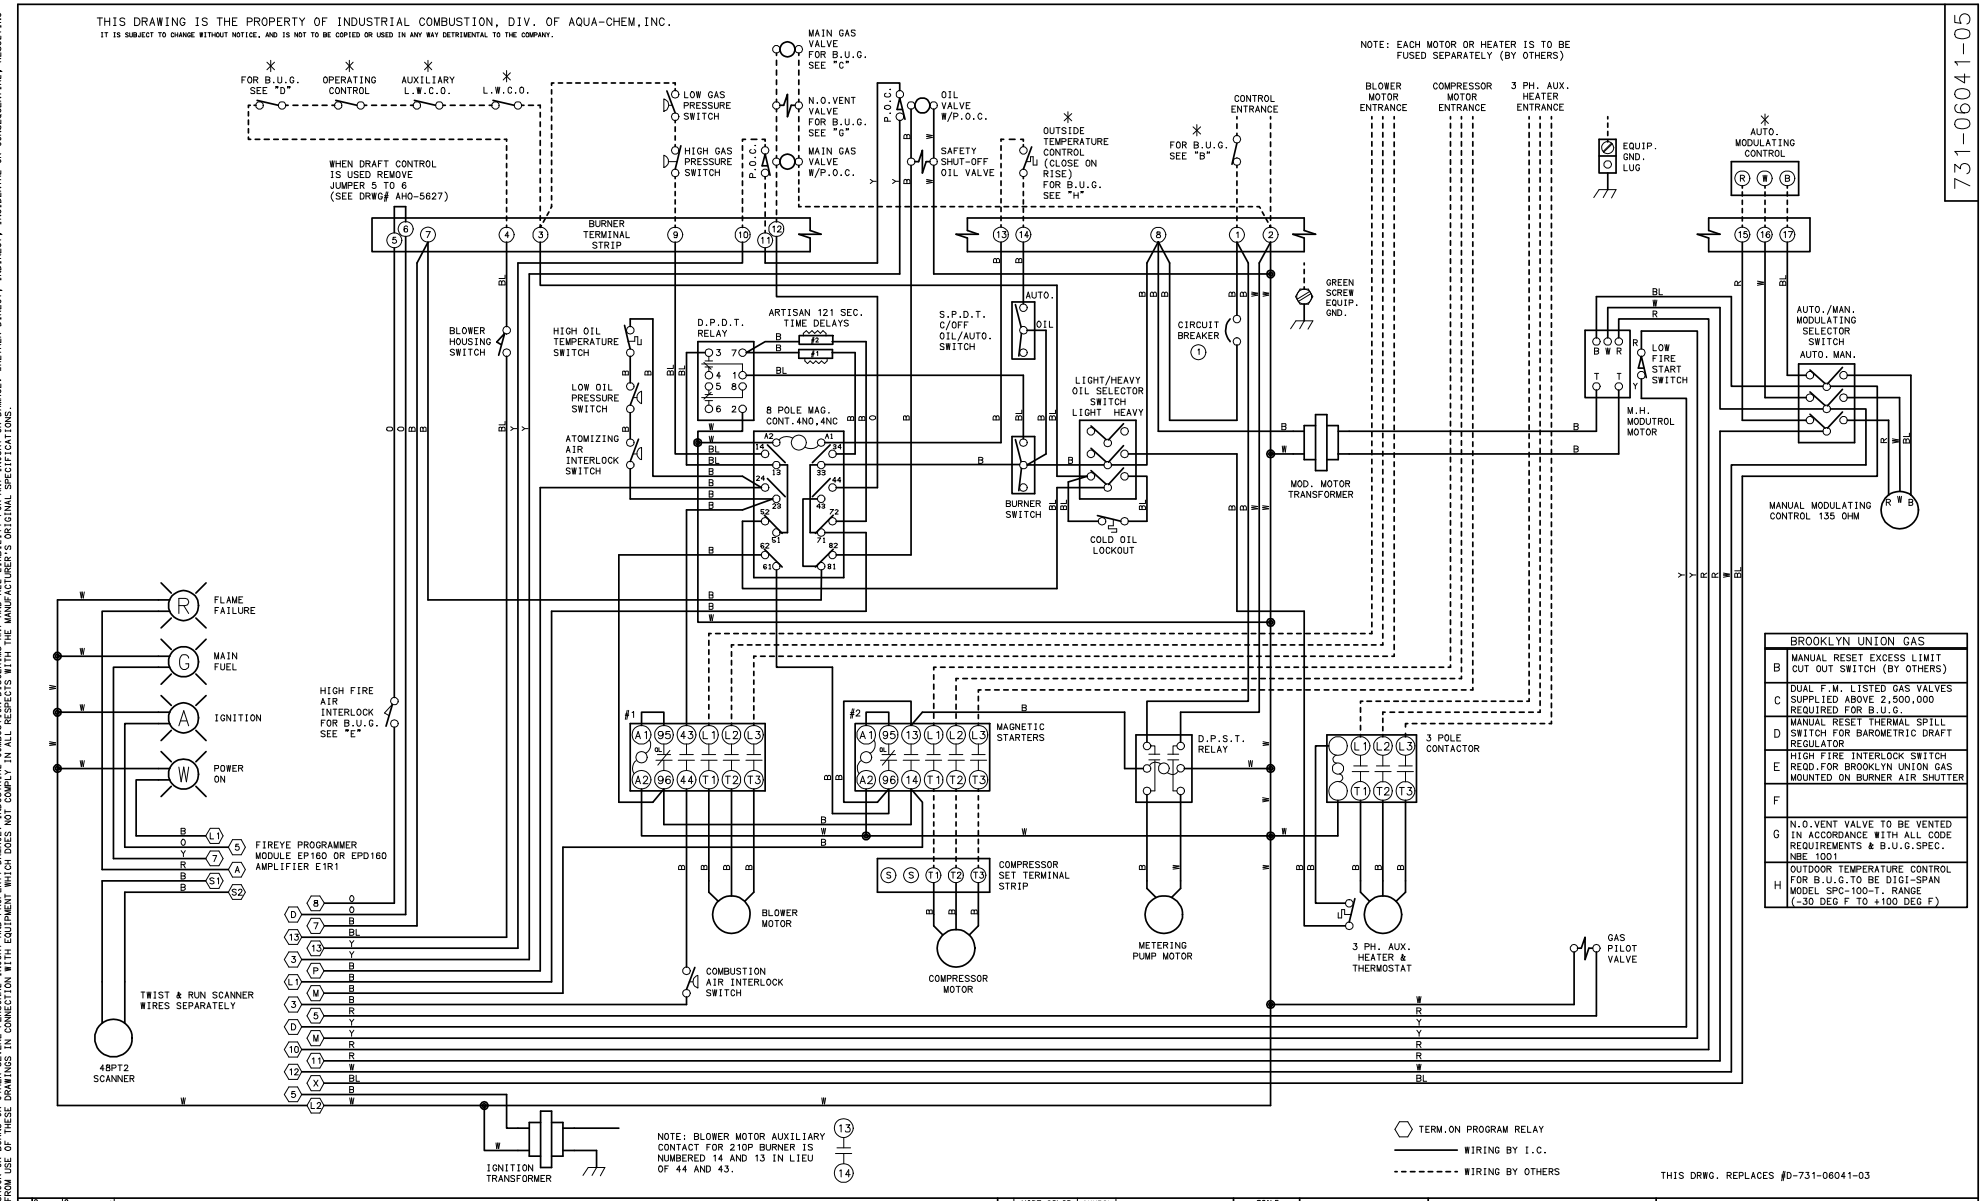

BROOKLYN UNION GAS	
B	MANUAL RESET EXCESS LIMIT CUT OUT SWITCH (BY OTHERS)
C	DUAL F.M. LISTED GAS VALVES SUPPLIED ABOVE 2,500,000 REQUIRED FOR B.U.G.
D	MANUAL RESET THERMAL SPILL SWITCH FOR BAROMETRIC DRAFT REGULATOR
E	HIGH FIRE INTERLOCK SWITCH REQD.FOR BROOKLYN UNION GAS MOUNTED ON BURNER AIR SHUTTER
F	
G	N.O.VENT VALVE TO BE VENTED IN ACCORDANCE WITH ALL CODE REQUIREMENTS & B.U.G.SPEC. NBE 1001
H	OUTDOOR TEMPERATURE CONTROL FOR B.U.G.TO BE DIGI-SPAN MODEL SPC-100-T. RANGE (-30 DEG F TO +100 DEG F)

WARNING: THESE DRAWINGS ARE TO BE USED ONLY IN CONNECTION WITH EQUIPMENT COMPLYING IN ALL RESPECTS WITH THE ORIGINAL MANUFACTURE'S SPECIFICATIONS. INSTALLER SHOULD INSPECT EQUIPMENT AND ASCERTAIN COMPLIANCE WITH ORIGINAL MANUFACTURER'S SPECIFICATIONS BEFORE INSTALLATION. ANY MODIFIED OR OTHERWISE NON-COMPLIANT EQUIPMENT MAY BE DANGEROUS, RESULTING IN FIRE, EXPLOSION, ELECTRIC SHOCK OR BURNS OR OTHER SEVERE PERSONAL INJURY AND PROPERTY DAMAGE. INDUSTRIAL COMBUSTION DISCLAIMS ANY AND ALL LIABILITY FOR ANY INJURY OR DAMAGE, WHETHER DIRECT, INDIRECT, INCIDENTAL OR CONSEQUENTIAL, RESULTING FROM USE OF THESE DRAWINGS IN CONNECTION WITH EQUIPMENT WHICH DOES NOT COMPLY IN ALL RESPECTS WITH THE MANUFACTURER'S ORIGINAL SPECIFICATIONS.

REVISIONS	
4	03/09/01 DP
	D.L. VALVE
5	09/05/02 DP
	BM AUXILIARY CONTACT NOTE ADDED FOR 210P BURNERS.

731 06041	WIRE COLOR	SYMBOL
	YELLOW	Y
	ORANGE	O
	RED	R
	BLUE	BL
	WHITE	W
	BLACK	B

WIRE ALL CIRCUITS N.E.C. CLASS 1. NOT RESPONSIBLE FOR WIRING NOT INSTALLED AT THE FACTORY.

(1) SUPPLEMENTARY LOW OVERCURRENT PROTECTION ONLY. FUSE NOT LARGER THAN 15 AMPS.

SCALE

DATE 04/01/94

DRAWN C.L.B.

* OPTIONAL EQUIPMENT NOT FURNISHED UNLESS SPECIFIED IN CONTRACT.

DEG-210P,252,300
LV-208/3/60
CC-120/1/60

INDUSTRIAL COMBUSTION
MONROE, WIS. DIVISION OF AQUA-CHEM, INC.

SIZE D | DRWG. NO. 731 06041 | 05