


THIS DRAWING IS THE PROPERTY OF INDUSTRIAL COMBUSTION, DIV. OF AQUA-CHEM, INC.
IT IS SUBJECT TO CHANGE WITHOUT NOTICE, AND IS NOT TO BE COPIED OR USED IN ANY WAY DETRIMENTAL TO THE COMPANY.

WARNING: THESE DRAWINGS ARE TO BE USED ONLY IN CONNECTION WITH EQUIPMENT COMPLYING IN ALL RESPECTS WITH THE ORIGINAL MANUFACTURER'S SPECIFICATIONS. INSTALLER SHOULD INSPECT EQUIPMENT AND ASCERTAIN COMPLIANCE WITH ORIGINAL MANUFACTURER'S SPECIFICATIONS BEFORE USING THESE DRAWINGS. DO NOT USE THESE DRAWINGS IF THE EQUIPMENT HAS BEEN MODIFIED, SUCH USE MAY CAUSE EQUIPMENT FAILURE OR MALFUNCTION WHICH MAY RESULT IN ELECTRICAL SHOCK OR BURNS OR OTHER SEVERE PERSONAL INJURY AND PROPERTY DAMAGE. INDUSTRIAL COMBUSTION DISCLAIMS ANY AND ALL LIABILITY FOR ANY INJURY OR DAMAGE, WHETHER DIRECT, INDIRECT, INCIDENTAL OR CONSEQUENTIAL, RESULTING FROM THE USE OF THESE DRAWINGS IN CONNECTION WITH EQUIPMENT WHICH DOES NOT COMPLY IN ALL RESPECTS WITH THE MANUFACTURER'S ORIGINAL SPECIFICATIONS.

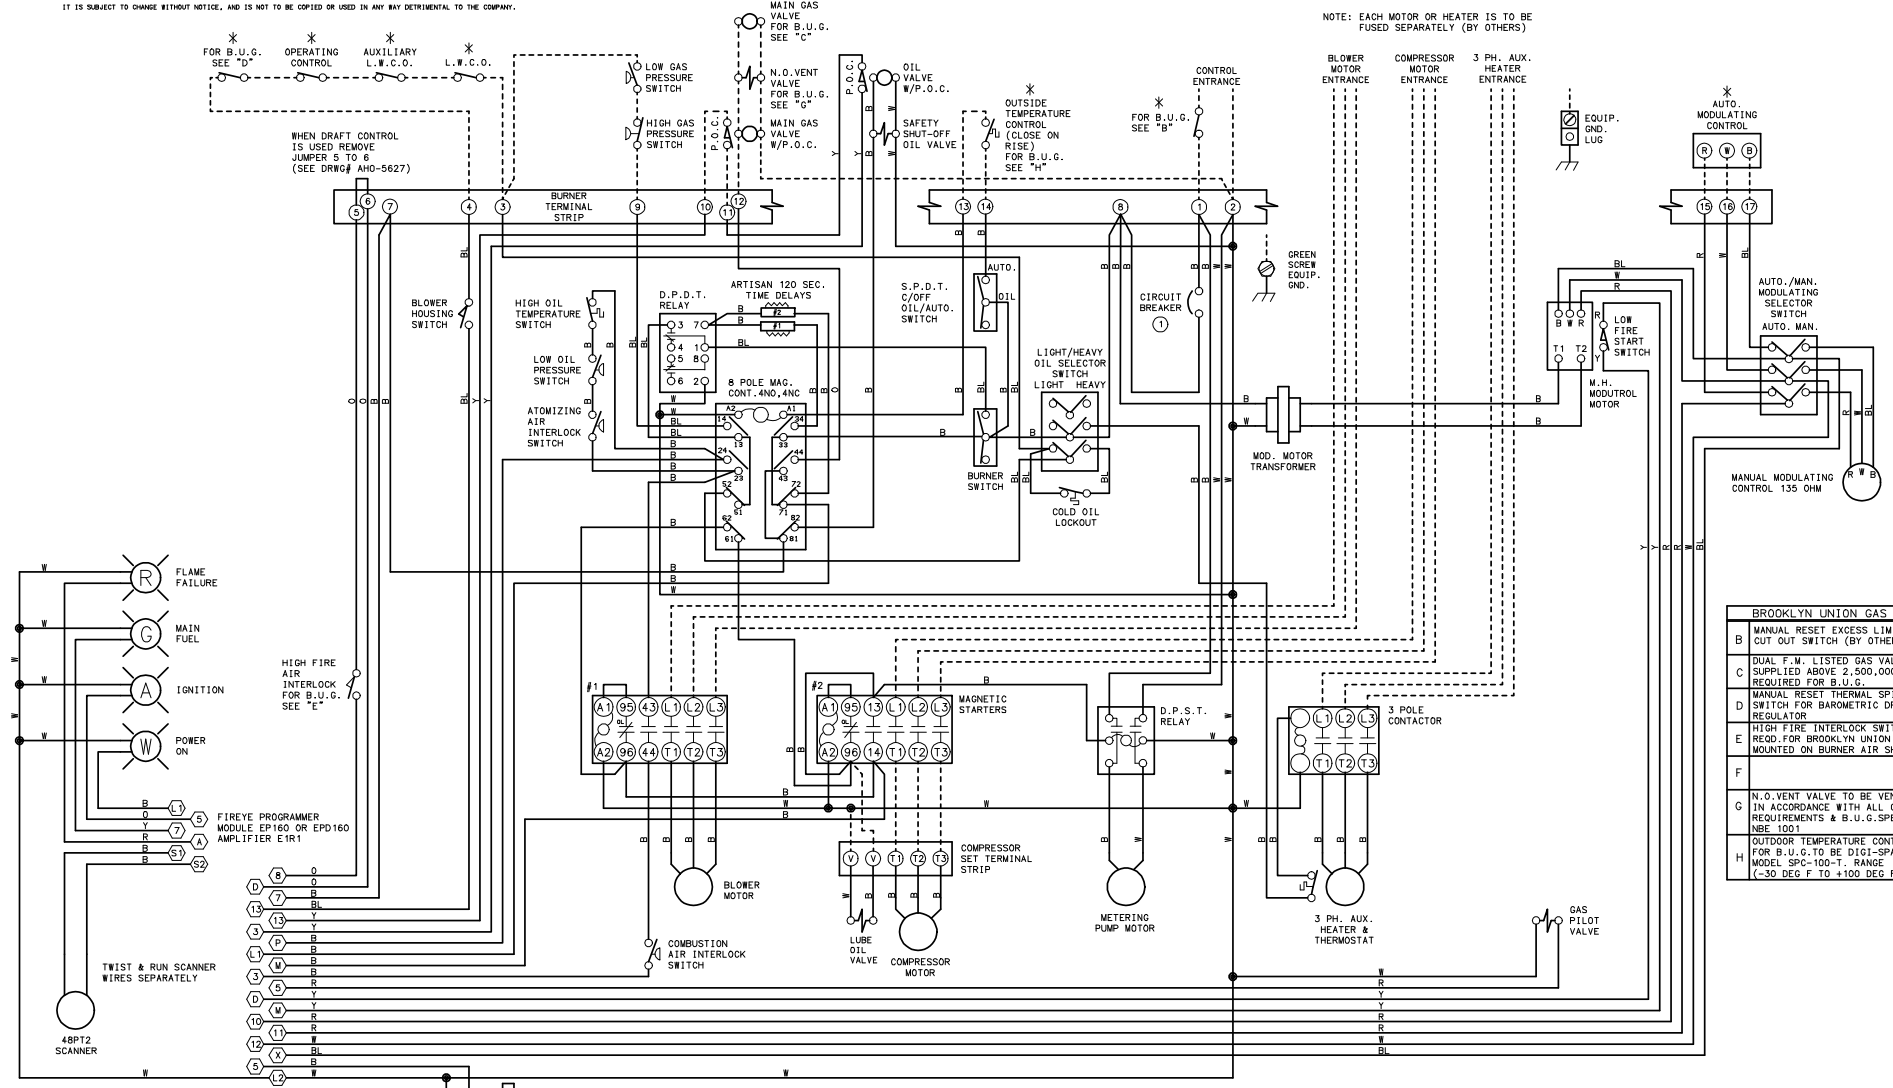

NOTE: EACH MOTOR OR HEATER IS TO BE FUSED SEPARATELY (BY OTHERS)

WHEN DRAFT CONTROL IS USED REMOVE JUMPER 5 TO 6 (SEE DRAWING AHO-5627)

NOTE: BLOWER MOTOR AUXILIARY CONTACT FOR 210P BURNER IS NUMBERED 14 AND 13 IN LIEU OF 44 AND 43.

BROOKLYN UNION GAS	
B	MANUAL RESET EXCESS LIMIT CUT OUT SWITCH (BY OTHERS)
C	DUAL F.W. LISTED GAS VALVES SUPPLIED ABOVE 2,500,000 REQUIRED FOR B.U.G.
D	SWITCH FOR BAROMETRIC DRAFT REGULATOR
E	HIGH FIRE INTERLOCK SWITCH REQD. FOR BROOKLYN UNION GAS MOUNTED ON BURNER AIR SHUTTER
F	MANUAL RESET THERMAL SPILL
G	N.O. VENT VALVE TO BE VENTED IN ACCORDANCE WITH ALL CODE REQUIREMENTS & B.U.G. SPEC. NBE 1001
H	OUTDOOR TEMPERATURE CONTROL FOR B.U.G. TO BE DIGI-SPAN MODEL SPC-100-T. RANGE (-30 DEG F TO +100 DEG F)

○ TERM. ON PROGRAM RELAY
— WIRING BY I.C.
- - - - - WIRING BY OTHERS

THIS DRWG. REPLACES #D-731-06041-03

REVISIONS	DATE	BY	DESCRIPTION
1	02/02/01	TP	OIL VALVE
2	09/02/04	TP	ADD AUXILIARY
3	09/02/04	TP	ADD TO
4	09/02/04	TP	ADD TO
5	09/02/04	TP	ADD TO
6	09/02/04	TP	ADD TO
7	09/02/04	TP	ADD TO
8	09/02/04	TP	ADD TO
9	09/02/04	TP	ADD TO
10	09/02/04	TP	ADD TO
11	09/02/04	TP	ADD TO
12	09/02/04	TP	ADD TO
13	09/02/04	TP	ADD TO
14	09/02/04	TP	ADD TO
15	09/02/04	TP	ADD TO
16	09/02/04	TP	ADD TO
17	09/02/04	TP	ADD TO
18	09/02/04	TP	ADD TO
19	09/02/04	TP	ADD TO
20	09/02/04	TP	ADD TO

WIRE COLOR	SYMBOL	WIRE ALL CIRCUITS N.E.C. CLASS 1: NOT RESPONSIBLE FOR WIRING NOT INSTALLED AT THE FACTORY.	SCALE
YELLOW	Y		
ORANGE	O		
RED	R		
BLUE	BL		
WHITE	W		
BLACK	B		

DATE	SCALE
04/01/94	C.L.B.

DEG-210P, 252, 300
LV-208/3/60
CC-120/1/60

INDUSTRIAL COMBUSTION
MONROE, WIS. DIVISION OF AQUA-CHEM, INC.

SIZE D DRWG. NO. 731 06041 06