


THIS DRAWING IS THE PROPERTY OF INDUSTRIAL COMBUSTION, DIV. OF AQUA-CHEM, INC.
 IT IS SUBJECT TO CHANGE WITHOUT NOTICE, AND IS NOT TO BE COPIED OR USED IN ANY WAY DETRIMENTAL TO THE COMPANY.

NOTE: EACH MOTOR OR HEATER IS TO BE
 FUSED SEPARATELY (BY OTHERS)

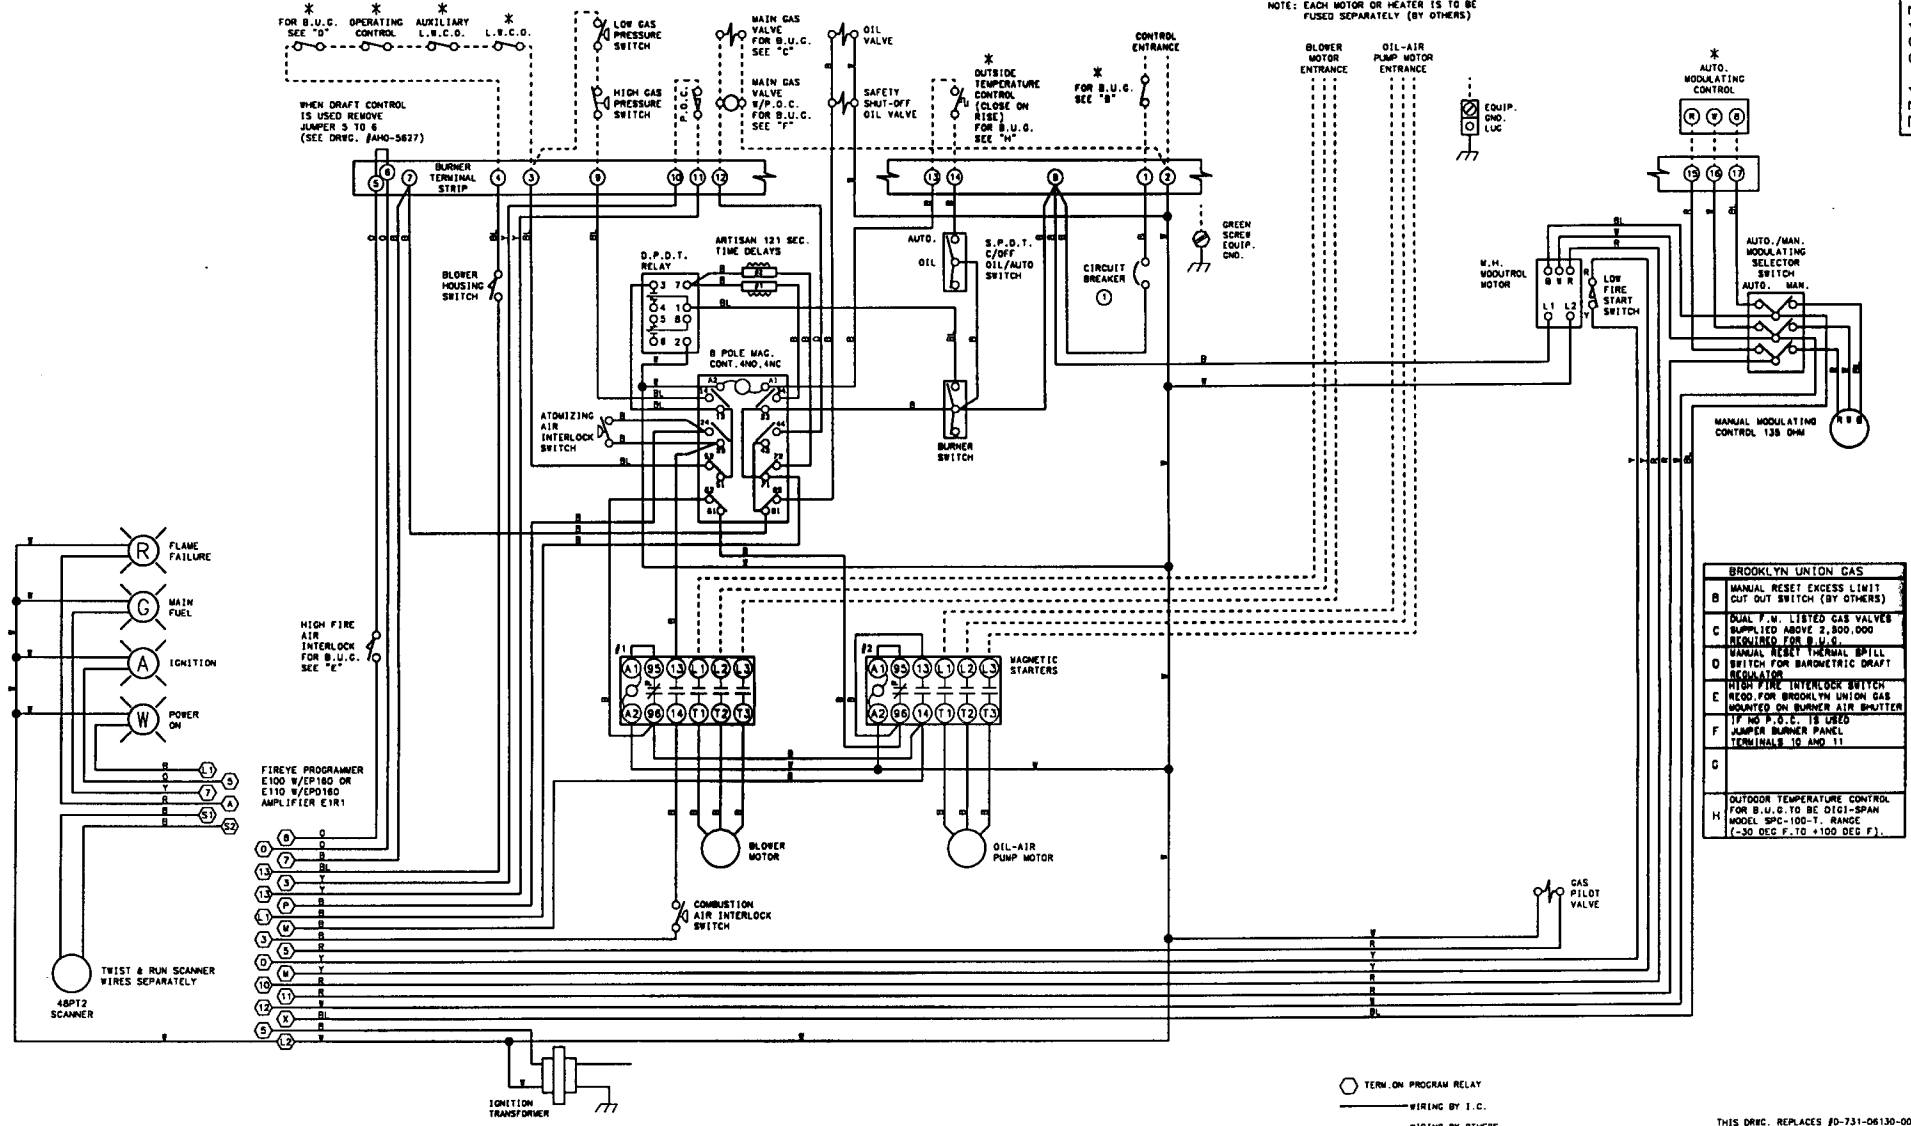

BROOKLYN UNION GAS	
B	MANUAL RESET EXCESS LIMIT CUT OUT SWITCH (BY OTHERS)
C	DUAL F.V. LISTED GAS VALVES SUPPLIED ABOVE 2,800,000 BPS/HR FOR B.U.C.
D	MANUAL RESET THERMAL SPILL REGULATOR
E	HIGH FIRE INTERLOCK SWITCH REQD. FOR BROOKLYN UNION GAS MOUNTED ON BURNER AIR SHUTTER IF NO P.O.C. IS USED
F	JUMPER BURNER PANEL TERMINALS 10 AND 11
G	
H	OUTDOOR TEMPERATURE CONTROL FOR B.U.C. TO BE DIGI-SPAN MODEL SP-100-T. RANGE (-30 DEG F. TO +100 DEG F.)

○ TERM. ON PROGRAM RELAY
 — WIRING BY I.C.
 - - - WIRING BY OTHERS

WIRE COLOR	SYMBOL	WIRE ALL CIRCUITS W.C.C. CLASS 1, NOT RESPONSIBLE FOR WIRING NOT INSTALLED AT THE FACTORY
YELLOW	Y	
ORANGE	O	
RED	R	
BLUE	BL	
WHITE	W	
BLACK	B	

* OPTIONAL EQUIPMENT NOT FURNISHED UNLESS SPECIFIED IN CONTRACT.

THIS DRWG. REPLACES #D-731-06130-00

INDUSTRIAL COMBUSTION
 A DIV. OF AQUA-CHEM, INC.

DATE	DEC-42, 54, 63, 84, 105
DRW	LY-190-600/3/80
CHK	CC-120/1/50
APP	ACT. I.C. 731-06130-01

WARNING: THESE DRAWINGS ARE TO BE USED ONLY IN CONNECTION WITH EQUIPMENT COMPLYING WITH THE ORIGINAL MANUFACTURER'S SPECIFICATIONS. INSTALLER SHOULD INSPECT EQUIPMENT AND ASCERTAIN COMPLIANCE WITH SUCH OR BURNS OR OTHER SEVERE PERSONAL INJURY AND PROPERTY DAMAGE. INDUSTRIAL COMBUSTION DISCLAIMS ANY AND ALL LIABILITY FOR ANY INJURY OR DAMAGE. THESE DIRECT, INDIRECT, INCIDENTAL OR CONSEQUENTIAL DAMAGES FROM USE OF THESE DRAWINGS IN CONNECTION WITH EQUIPMENT WHICH DOES NOT COMPLY IN ALL RESPECTS WITH THE MANUFACTURER'S ORIGINAL SPECIFICATIONS.

REVISIONS AS SHOWN BY CIRCLED NUMBERS. REVISIONS NOT SHOWN BY CIRCLED NUMBERS ARE BY THE ORIGINAL DESIGNER.