


THIS DRAWING IS THE PROPERTY OF INDUSTRIAL COMBUSTION.
IT IS SUBJECT TO CHANGE WITHOUT NOTICE, AND IS NOT TO BE COPIED OR USED IN ANY WAY DETRIMENTAL TO THE COMPANY.

WARNING: THESE DRAWINGS ARE TO BE USED ONLY IN CONNECTION WITH EQUIPMENT COMPLYING IN ALL RESPECTS WITH THE ORIGINAL MANUFACTURER'S SPECIFICATIONS. INSTALLER SHOULD INSPECT EQUIPMENT AND ASCERTAIN COMPLIANCE WITH ORIGINAL MANUFACTURER'S SPECIFICATIONS BEFORE USING THESE DRAWINGS. DO NOT USE THESE DRAWINGS IF THE EQUIPMENT HAS BEEN MODIFIED, SUCH USE MAY CAUSE EQUIPMENT FAILURE OR MALFUNCTION WHICH MAY RESULT IN ELECTRICAL SHOCK OR BURNS OR OTHER SEVERE PERSONAL INJURY AND PROPERTY DAMAGE. INDUSTRIAL COMBUSTION DISCLAIMS ANY AND ALL LIABILITY FOR ANY INJURY OR DAMAGE, WHETHER DIRECT, INDIRECT, INCIDENTAL OR CONSEQUENTIAL, RESULTING FROM USE OF THESE DRAWINGS IN CONNECTION WITH EQUIPMENT WHICH DOES NOT COMPLY IN ALL RESPECTS WITH THE MANUFACTURER'S ORIGINAL SPECIFICATIONS.

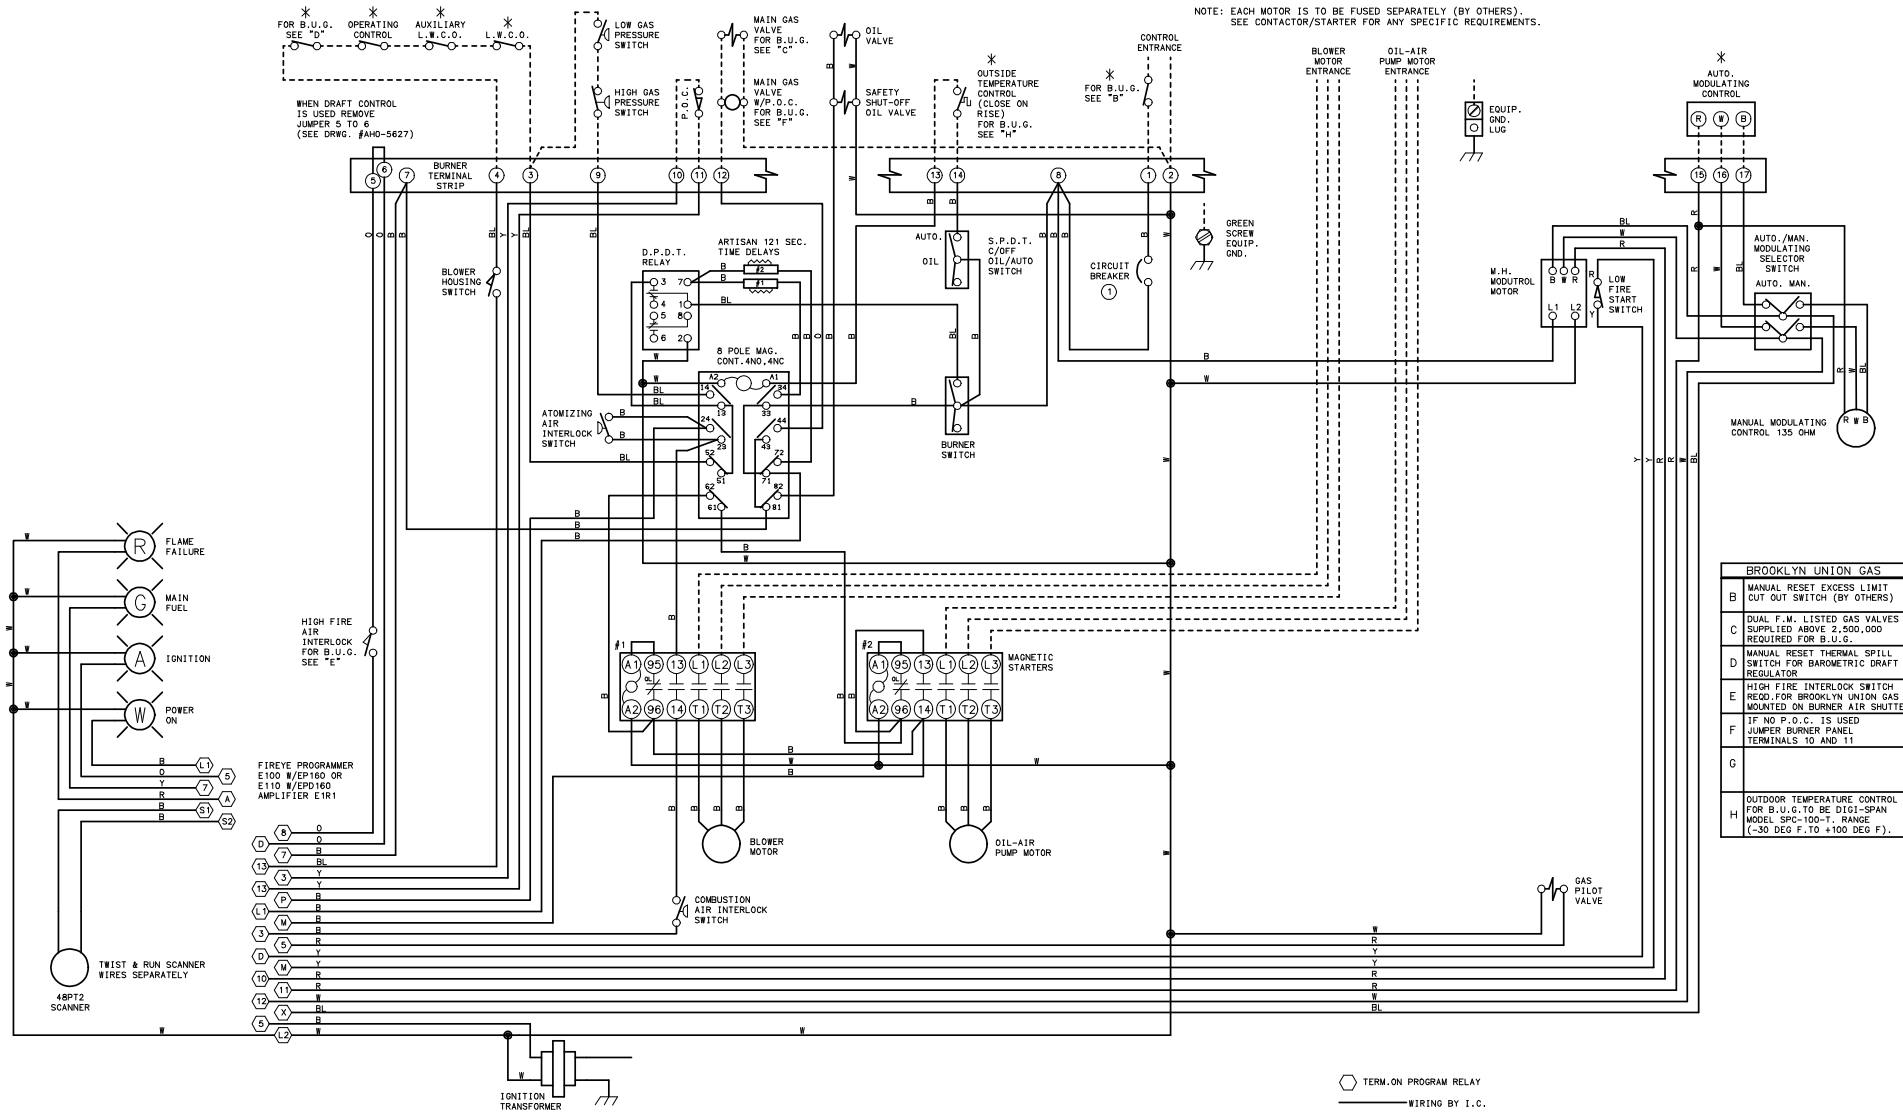

NOTE: EACH MOTOR IS TO BE FUSED SEPARATELY (BY OTHERS).
SEE CONTACTOR/STARTER FOR ANY SPECIFIC REQUIREMENTS.

WHEN DRAFT CONTROL IS USED REMOVE JUMPER 5 TO 6 (SEE DRWG. #AHO-5627)

BROOKLYN UNION GAS	
B	MANUAL RESET EXCESS LIMIT OUT OUT SWITCH (BY OTHERS)
C	DUAL F.M. LISTED GAS VALVES SUPPLIED ABOVE 2,500,000 BTU REQUIRED FOR B.U.G.
D	MANUAL RESET THERMAL SPILL SWITCH FOR BAROMETRIC DRAFT REGULATOR
E	HIGH FIRE INTERLOCK SWITCH REQD. FOR BROOKLYN UNION GAS MOUNTED ON BURNER AIR SHUTTER
F	IF NO P.O.C. IS USED JUMPER BURNER PANEL TERMINALS 10 AND 11
G	
H	OUTDOOR TEMPERATURE CONTROL FOR B.U.G. TO BE D101-SPAN MODEL, SPC-100-T, RANGE (-30 DEG F. TO +100 DEG F.).

◻ TERM. ON PROGRAM RELAY
— WIRING BY I.C.
- - - WIRING BY OTHERS

THIS DRWG. REPLACES #D-731-06130-00

REV.	DATE	DESCRIPTION
1	11/17/02	REVISIONS
2	05/17/03	SPOT RELAY
3	05/17/03	REVISIONS
4	05/17/03	REVISIONS
5	05/17/03	REVISIONS
6	05/17/03	REVISIONS
7	05/17/03	REVISIONS
8	05/17/03	REVISIONS
9	05/17/03	REVISIONS
10	05/17/03	REVISIONS
11	05/17/03	REVISIONS
12	05/17/03	REVISIONS
13	05/17/03	REVISIONS
14	05/17/03	REVISIONS
15	05/17/03	REVISIONS
16	05/17/03	REVISIONS
17	05/17/03	REVISIONS
18	05/17/03	REVISIONS
19	05/17/03	REVISIONS
20	05/17/03	REVISIONS
21	05/17/03	REVISIONS
22	05/17/03	REVISIONS
23	05/17/03	REVISIONS
24	05/17/03	REVISIONS
25	05/17/03	REVISIONS
26	05/17/03	REVISIONS
27	05/17/03	REVISIONS
28	05/17/03	REVISIONS
29	05/17/03	REVISIONS
30	05/17/03	REVISIONS

WIRE COLOR	SYMBOL	WIRE ALL CIRCUITS N.E.C. CLASS 1; NOT RESPONSIBLE FOR WIRING NOT INSTALLED AT THE FACTORY.	SCALE	DATE
YELLOW	Y			
ORANGE	O			
RED	R			
BLUE	B			
WHITE	W			
BLACK	B			

DATE	SCALE
05/23/94	AS SHOWN

* OPTIONAL EQUIPMENT NOT FURNISHED UNLESS SPECIFIED IN CONTRACT.
DLG-42, 54, 63, 84, 105
LV-190-600/3/60
CC-120/1/60

IC INDUSTRIAL COMBUSTION
MONROE, WIS.

SIZE D DRWG. NO. 731 06130 03