


THIS DRAWING IS THE PROPERTY OF INDUSTRIAL COMBUSTION, DIV. OF AQUA-CHEM, INC.
 IT IS SUBJECT TO CHANGE WITHOUT NOTICE, AND IS NOT TO BE COPIED OR USED IN ANY WAY DETRIMENTAL TO THE COMPANY.

NOTE: EACH MOTOR OR HEATER IS TO BE FUSED SEPARATELY (BY OTHERS)

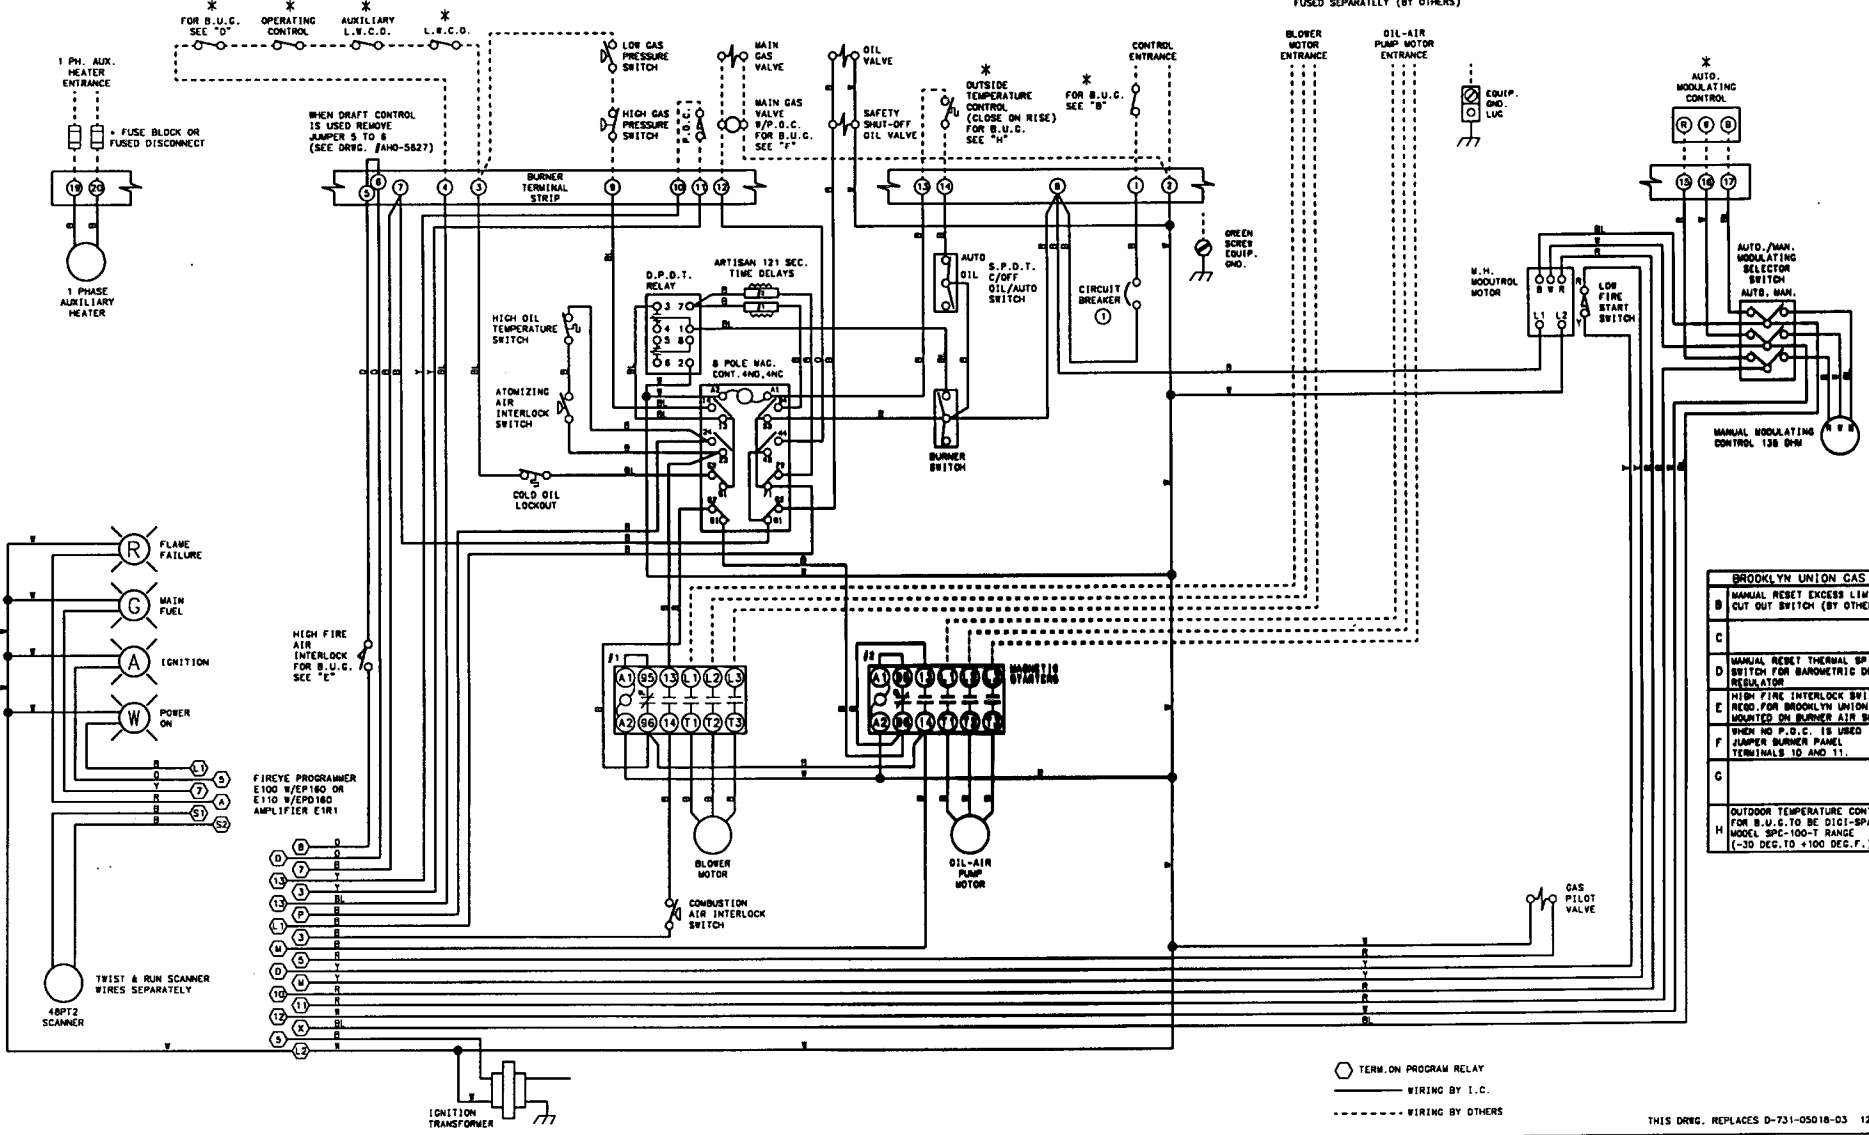

BROOKLYN UNION GAS	
B	MANUAL RESET EXCESS LIMIT OUT OUT SWITCH (BY OTHERS)
C	
D	MANUAL RESET THERMAL SPILL SWITCH FOR BAROMETRIC DRAFT REGULATOR
E	HIGH FIRE INTERLOCK SWITCH REQD. FOR BROOKLYN UNION GAS MOUNTED ON BURNER AIR SHUTTER
F	JUMPER BURNER PANEL TERMINALS 10 AND 11.
G	
H	OUTDOOR TEMPERATURE CONTROL FOR B.U.G. TO BE DICI-SPAN MODEL SP-100-T RANGE (-30 DEG. TO +100 DEG. F.)

○ TERM. ON PROGRAM RELAY
 — WIRING BY I. C.
 - - - WIRING BY OTHERS

THIS DRWG. REPLACES D-731-05018-03 12/27/94

WARNING: THESE DRAWINGS ARE TO BE USED ONLY IN CONNECTION WITH EQUIPMENT COMPLYING IN ALL RESPECTS WITH THE ORIGINAL MANUFACTURER'S SPECIFICATIONS. INSTALLER SHOULD INSPECT EQUIPMENT AND ASCERTAIN COMPLIANCE WITH THE ORIGINAL MANUFACTURER'S SPECIFICATIONS. DO NOT USE THESE DRAWINGS FOR EQUIPMENT THAT DOES NOT COMPLY WITH THE ORIGINAL MANUFACTURER'S SPECIFICATIONS. SUCH USE MAY CAUSE EQUIPMENT FAILURE OR MALFUNCTION, WHICH MAY RESULT IN ELECTRICAL SHOCK OR BURNING OR OTHER SEVERE PERSONAL INJURY. ALWAYS DISCONNECT MAIN POWER TO THE EQUIPMENT BEFORE WORKING ON IT. THESE DRAWINGS ARE THE PROPERTY OF INDUSTRIAL COMBUSTION, DIV. OF AQUA-CHEM, INC. AND ARE NOT TO BE COPIED OR USED IN ANY WAY DETRIMENTAL TO THE COMPANY.

REVISIONS
 12/27/94
 12/27/94
 12/27/94

WIRE COLOR	SYMBOL	WIRE ALL CIRCUITS N.E.C. CLASS 1; NOT RESPONSIBLE FOR WIRING NOT INSTALLED AT THE FACTORY.	OPTIONAL EQUIPMENT NOT FURNISHED UNLESS SPECIFIED IN CONTRACT.	INDUSTRIAL COMBUSTION 1000 W. 111th ST. NEW YORK, N.Y. 10026 TEL: (212) 342-5453 FAX: (212) 342-5453 12/27/94 731-06557-01
YELLOW	Y			
ORANGE	O			
RED	R			
BLUE	BL			
WHITE	W			
BLACK	B			