THIS DRAWING IS THE PROPERTY OF INDUSTRIAL COMBUSTION.
IT IS SUBJECT TO CHANGE WITHOUT NOTICE, AND IS NOT TO BE COPIED OR USED IN ANY WAY DETRIMENTAL TO THE COMPANY.

WARNING: THESE DRAWINGS ARE TO BE USED ONLY IN CONNECTION WITH EQUIPMENT COMPLYING IN ALL RESPECTS WITH THE ORIGINAL MANUFACTURE'S SPECIFICATIONS. INSTALLER SHOULD INSPECT EQUIPMENT AND ASCERTAIN COMPLIANCE WITH OPTIONAL MANUFACTURER'S SPECIFICATIONS BEFORE STARTING WORK. INSTALLER SHOULD ALSO INSPECT EQUIPMENT AFTER WORK TO ASCERTAIN THAT NO DAMAGE HAS BEEN CAUSED. INDUSTRIAL COMBUSTION DISCLAIMS ANY AND ALL LIABILITY FOR ANY INJURY OR DAMAGE: WHETHER DIRECT, INDIRECT, INCIDENTAL OR CONSEQUENTIAL, RESULTING FROM USE OF THESE DRAWINGS IN CONNECTION WITH EQUIPMENT WHICH DOES NOT COMPLY IN ALL RESPECTS WITH THE MANUFACTURER'S ORIGINAL SPECIFICATIONS.

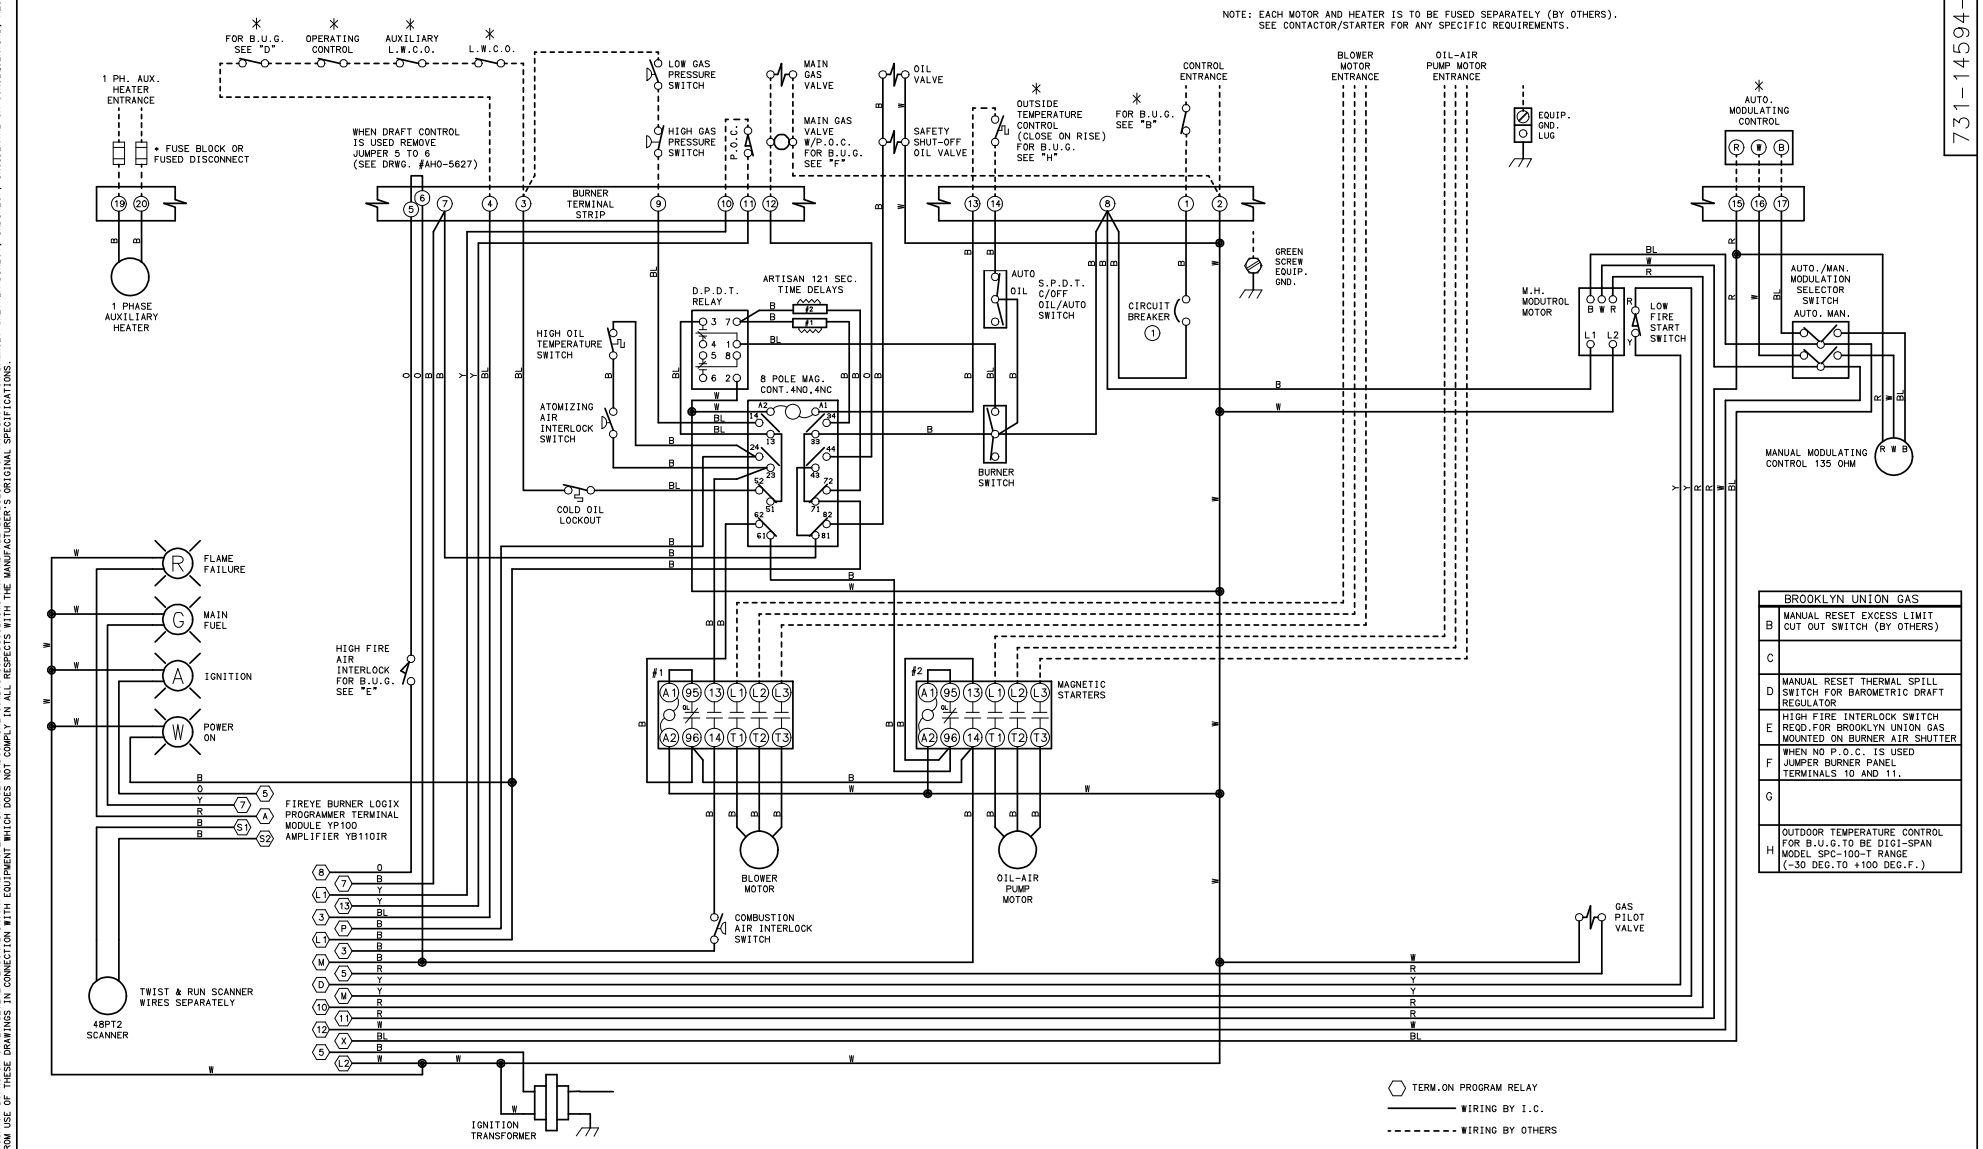

BROOKLYN UNION GAS	
B	MANUAL RESET EXCESS LIMIT CUT OUT SWITCH (BY OTHERS)
C	
D	MANUAL RESET THERMAL SPILL SWITCH FOR BAROMETRIC DRAFT REGULATOR
E	HIGH FIRE INTERLOCK SWITCH REQD.FOR BROOKLYN UNION GAS MOUNTED ON BURNER AIR SHUTTER
F	WHEN NO P.O.C. IS USED JUMPER BURNER PANEL TERMINALS 10 AND 11.
G	
H	OUTDOOR TEMPERATURE CONTROL FOR B.U.G.TO BE DIGI-SPAN MODEL SPC-100-T RANGE (-30 DEG.TO +100 DEG.F.)

REVISIONS

731 14594	WIRE COLOR	SYMBOL
	YELLOW	Y
	ORANGE	O
	RED	R
	BLUE	BL
	WHITE	W
	BLACK	B

WIRE ALL CIRCUITS N.E.C. CLASS 1. NOT RESPONSIBLE FOR WIRING NOT INSTALLED AT THE FACTORY.

(1) SUPPLEMENTARY LOW OVERCURRENT PROTECTION ONLY. FUSE NOT LARGER THAN 15 AMPS.

SCALE

DATE 11/08/06

DRAWN D.R.P.

* OPTIONAL EQUIPMENT NOT FURNISHED UNLESS SPECIFIED IN CONTRACT.

MMG-28,30,34,42,54,63
LV-190-600/3/60
CC-120/1/60

INDUSTRIAL COMBUSTION
MONROE, WIS.

SIZE D | DRWG. NO. 731-14594 | 00