


THIS DRAWING IS THE PROPERTY OF INDUSTRIAL COMBUSTION, LLC  
IT IS SUBJECT TO CHANGE WITHOUT NOTICE, AND IS NOT TO BE COPIED OR USED IN ANY WAY DETRIMENTAL TO THE COMPANY.

WHEN VALVE PROVING IS ADDED EACH GAS VALVE AND MAIN GAS VALVE TERMINAL MUST BE WIRED SEPARATELY TO VALVE PROVING CONTROL. (SEE DRWG. #731-15168)

NOTE: EACH MOTOR AND HEATER IS TO BE FUSED SEPARATELY (BY OTHERS).  
SEE CONTACTOR/STARTER FOR ANY SPECIFIC REQUIREMENTS.

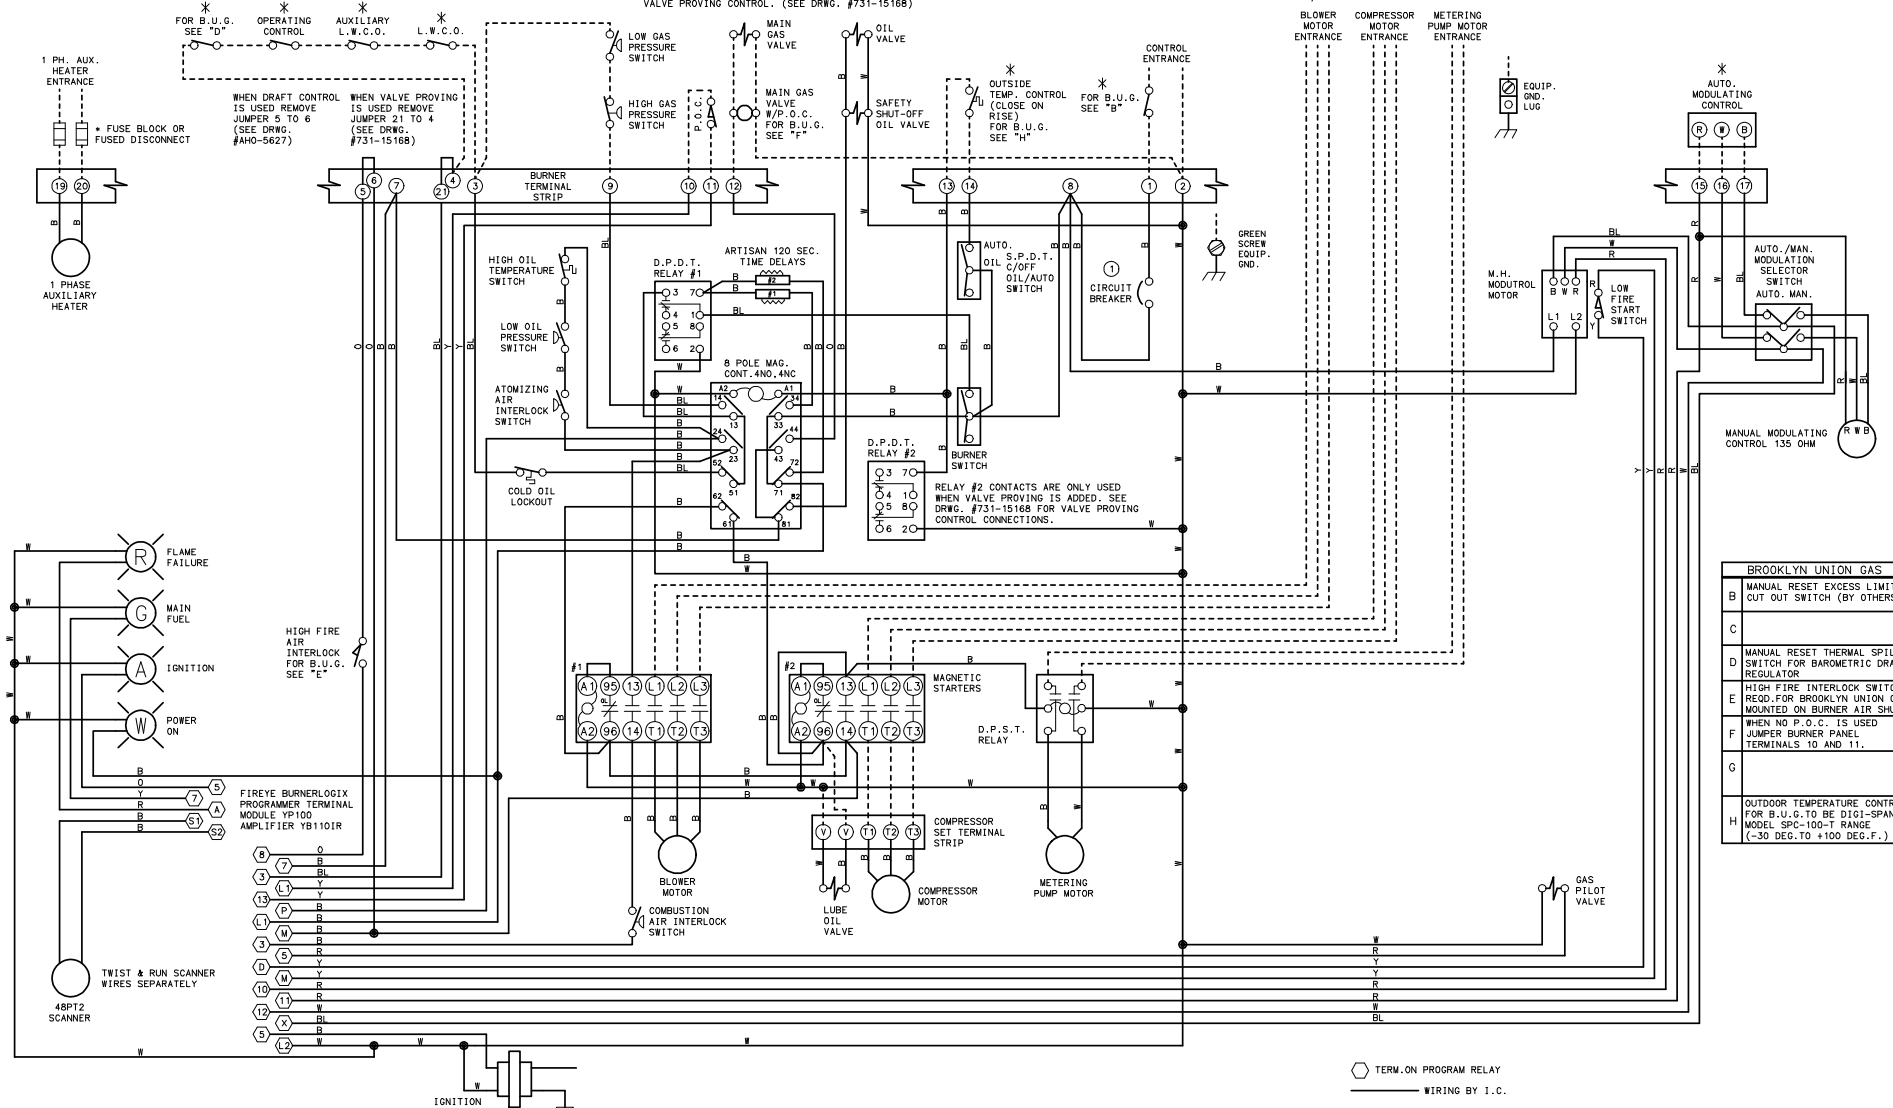

WARNING: THESE DRAWINGS ARE TO BE USED ONLY IN CONNECTION WITH EQUIPMENT COMPLYING IN ALL RESPECTS WITH THE ORIGINAL MANUFACTURER'S SPECIFICATIONS. INSTALLER SHOULD INSPECT EQUIPMENT AND ASCERTAIN COMPLIANCE WITH ORIGINAL MANUFACTURER'S SPECIFICATIONS BEFORE USING THESE DRAWINGS. DO NOT USE THESE DRAWINGS IF THE EQUIPMENT HAS BEEN MODIFIED, SUCH USE MAY CAUSE EQUIPMENT FAILURE OR MALFUNCTION WHICH MAY RESULT IN ELECTRICAL SHOCK OR BURNS OR OTHER SEVERE PERSONAL INJURY AND PROPERTY DAMAGE. INDUSTRIAL COMBUSTION DISCLAIMS ANY AND ALL LIABILITY FOR ANY INJURY OR DAMAGE, WHETHER DIRECT, INDIRECT, INCIDENTAL OR CONSEQUENTIAL, RESULTING FROM USE OF THESE DRAWINGS IN CONNECTION WITH EQUIPMENT WHICH DOES NOT COMPLY IN ALL RESPECTS WITH THE MANUFACTURER'S ORIGINAL SPECIFICATIONS.

REVISIONS  
11/20/09/07/JP  
RELAY #2 COIL  
ON REWISED.

WIRE COLOR	SYMBOL	WIRE ALL CIRCUITS N.E.C. CLASS 1: NOT RESPONSIBLE FOR WIRING NOT INSTALLED AT THE FACTORY.	SCALE
YELLOW	Y		
ORANGE	O		
RED	R		
BLUE	BL	(D) SUPPLEMENTARY LOW OVERCURRENT PROTECTION ONLY. FUSE NOT LARGER THAN 15 AMPS.	
WHITE	W		
BLACK	B		

DATE	DATE	OPTIONAL EQUIPMENT NOT FURNISHED UNLESS SPECIFIED IN CONTRACT.
09/20/07	09/20/07	
DRWN	DRWN	J.S.P.

MEG-34, 42, 54, 63  
LV-190-600/3/60  
CC-120/1/60

INDUSTRIAL COMBUSTION, LLC  
SIZE D DRWG. NO. 731-15184 01

BROOKLYN UNION GAS	
B	MANUAL RESET EXCESS LIMIT CUT OUT SWITCH (BY OTHERS)
C	
D	MANUAL RESET THERMAL SPILL SWITCH FOR BAROMETRIC DRAFT REGULATOR
E	HIGH FIRE INTERLOCK SWITCH REQD. FOR BROOKLYN UNION GAS MOUNTED ON BURNER AIR SHUTTER
F	WHEN NO P.O.C. IS USED JUMPER BURNER PANEL TERMINALS 10 AND 11.
G	
H	OUTDOOR TEMPERATURE CONTROL FOR B.U.G. TO BE DIGI-SPAN MODEL: SPC-100-T RANGE (-30 DEG. TO +100 DEG. F.)